



## **Town of Arnprior 2023 – Water Filtration Plant Summary Report**

February 23, 2023

Please find below a discussion of the operational undertakings of the Town of Arnprior's Water Filtration Plant (WFP) for the 2023 calendar year. This report is provided to meet the Town's requirements to report annually on the operation of the WFP, as per Municipal Drinking Water License (MDWL) 170-101 Ver. 7 and Schedule 22 of O. Reg. 170/03 (Drinking Water Systems) and to provide residents of the Town of Arnprior with information on an important piece of the Town's municipal infrastructure.

### **1.0 Regulatory Reporting Requirements**

Hereafter, for clarity all requirements of Schedule 22 of O. Reg. 170/03 are listed in blue italics below.

*22-2. (1) The owner of a drinking water system shall ensure that, not later than March 31 of each year after 2003, a report is prepared in accordance with subsections (2) and (3) for the preceding calendar year and is given to,*

*(a) in the case of a drinking water system owned by a municipality, the members of the municipal council.*

This report is to be presented to the Council of the Town of Arnprior during the regular meeting of Council on March 25, 2024 reporting on the Arnprior Drinking Water System for the period covering January to December 2023.

*(2) The report must,*

*(a) list the requirements of the Act, the regulations, the system's approval, drinking water works permit, municipal drinking water licence, and any orders applicable to the system that were not met at any time during the period covered by the report; and*

The Town of Arnprior's Drinking Water System Number is 220000932 and is operated under Municipal Drinking Water Licence (MDWL) 170-101, Ver. 7. The Drinking Water Works Permit (DWWP) number is 170-201 Ver. 3 and the current Permit to Take Water (PTTW) P-300-1179150700 Ver. 1.

### **2.0 Compliance with Terms and Conditions of the MDWL**

The Town of Arnprior owns and operates the Water Filtration Plant and complies with the conditions of the DWWP, PTTW, and MDWL.

### **3.0 WFP Plant changes and Improvements**

- Purchase of HACH pH probe.
- Annual chlorine gas safety maintenance completed by contractor including service, components, and equipment.
- Improvements to low lift pump communications.
- Improvements to backflow valve and PRV of fluoride dosing system.
- Fluoride tank level sensors replaced.
- Online fluoride probe replaced.
- Purchase of various health and safety equipment.
- Hoses of soda ash dosing pumps replaced.
- Purchase of chlorine gas parts/maintenance packages as spares.
- Purchase of updated coagulant dosing package.

In accordance with Ontario Regulation 107/03, all required sampling and laboratory analysis of the raw and treated water is carried out in the plant laboratory, as well as a certified contracted laboratory, which includes annual, quarterly and weekly sampling requirements.

Flow meters are calibrated annually by an outside contractor for flow measurement of the water taken from the Madawaska River and to the distribution system.

Continuous water quality analyzers with alarm systems are installed for chlorine residual, turbidity of filtered water and fluoride residual.

All operators are certified to the appropriate level, with ongoing training taking place throughout the year.

### **4.0 Non-Compliance with Terms and Conditions of PTTW and MDWL**

*(2) The report must,*

*(b) for each requirement referred to in clause (a) that was not met, specify the duration of the failure and the measures that were taken to correct the failure.*

In regards to non-compliance of PTTW and MDWL, there were no occurrences to report this period.

### **5.0 Adverse Test Results and Other Operational Problems**

- On January 24<sup>th</sup>, a mechanical failure on the backpressure regulator of the fluoride dosing system caused an adverse test result.
- The system was placed out of service while contractor performed necessary repairs. The system resumed regular functions by February 25<sup>th</sup>.

## 6.0 Water Production Flow Measurement

The raw water and the backwash flows at the plant are measured by Endress + Hauser electromagnetic flow meters. These flow meters are calibrated annually by an outside contractor.

## 7.0 Raw Water Production

*(3) The report must also include the following information for the purpose of enabling the owner of the system to assess the capability of the system to meet existing and planned uses of the system:*

- 1. A summary of the quantities and flow rates of the water supplied during the period covered by the report, including monthly average and maximum daily flows.*
- 2. A comparison of the summary referred to in paragraph 1 to the rated capacity and flow rates approved in the system's approval, drinking water works permit or municipal drinking water licence.*

The average daily raw water flow was measured at 4,489 m<sup>3</sup>. The maximum daily flow recorded was 5,764 m<sup>3</sup> on June 4<sup>th</sup>, 2023. The maximum daily flow permitted under the Town's current PTTW from the Madawaska River is 10,340 m<sup>3</sup>/day.


The total annual raw water flow for 2023 was 1,643,630 m<sup>3</sup>. This volume has decreased since 2022 which had a total flow of 1,837,928 m<sup>3</sup>, a decrease of 10.6%.

## 8.0 Treated Water Production

The maximum daily volume of water permitted to be treated by the Town at the WFP under the MDWL in 2023 was 10,340 m<sup>3</sup>/day. There were no flow exceedances in 2023 and the average daily treated water flow was measured at 3,877 m<sup>3</sup>/day. The maximum daily treated water flow was 5,129 m<sup>3</sup> on June 4<sup>th</sup>, 2023.

The total annual treated water flow for 2023 was 1,415,563 m<sup>3</sup>. This volume has decreased 10% as compared to 2022 which had a total flow of 1,581,830 m<sup>3</sup>.

Please see following chart showing annual treated water flows for the years 2018 to 2023.

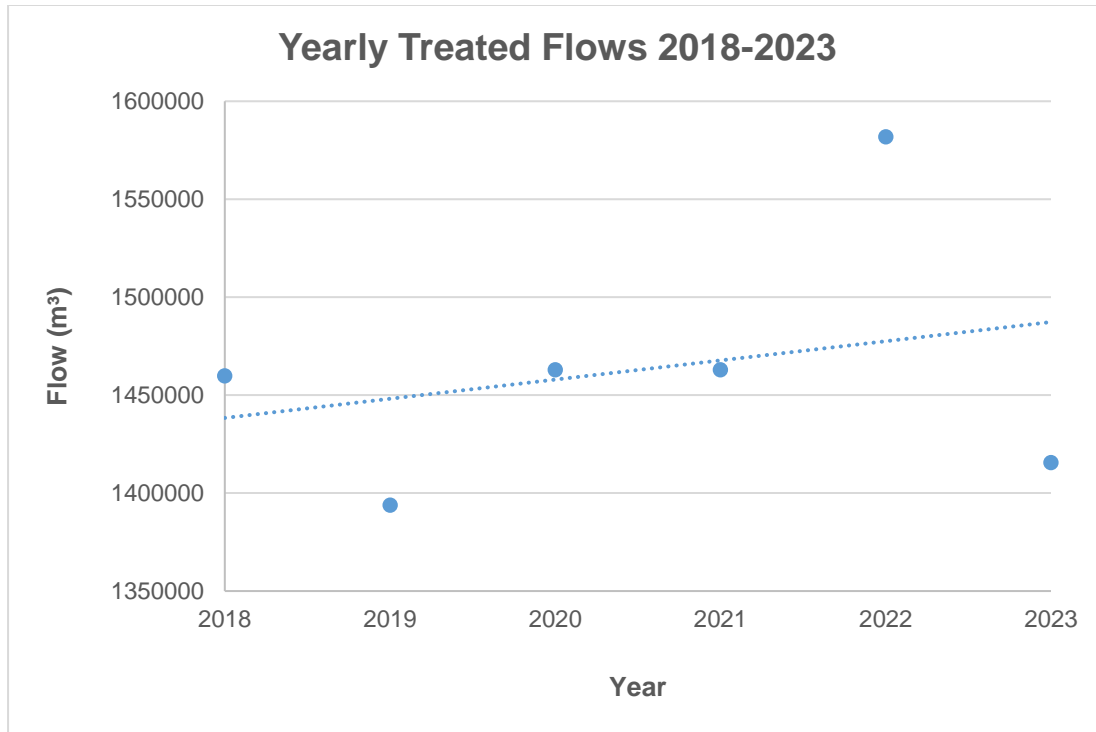

## 9.0 Backwash Water Production

The average monthly backwash water flow was 471 m<sup>3</sup>. The total annual backwash water flow was 171,785 m<sup>3</sup>. The backwash water is treated in a residuals treatment system where the solids are removed and pumped to the Water Pollution Control Centre (WPCC) for treatment and the clear supernatant is directed to the Madawaska River. The WFP MDWL stipulates a maximum permitted concentration of Total Suspended Solids (TSS) of 25 mg/L in the supernatant and in 2023 the average was 4.0 mg/L.

## 10.0 Water Quality

The Town of Arnprior carries out all the sampling and analysis of the raw and treated water as per the requirements of the MDWL and O. Reg. 170/03, schedules 10, 13, 23 and 24. s. Certain parameters are done at different frequencies such as daily weekly, quarterly and annually.

## 11.0 Zebra Mussels

Zebra mussels are evident at the Low Lift Pumphouse. At this time, they are manageable with semi-annual cleaning of the intake screens.

## 12.0 Turbidity

The Madawaska River is an excellent source of raw water with stable water turbidity. The

performance criterion for filtered water is a turbidity of less than or equal to 0.3 Nephelometric Turbidity Units (NTU) in 95% of the measurements each month without exceeding 1.0 NTU. The 2023 filtered water turbidity was 0.093 NTU.

### **13.0 Quarterly and Annual Water Sampling**

Sampling and testing were carried out at various frequencies for Volatile Organic Compounds, Inorganic compounds, Pesticides and PCB as per Schedule 23 and 24 of O. Reg. 170/03. These samples are taken by operators and sent to a certified laboratory. The analytical revealed that all samples were within acceptable concentrations under the Ontario Drinking Water Standards.

### **14.0 Hardness**

The recommended operational guideline for hardness is 80 mg/L expressed as Calcium Carbonate. This provides an acceptable balance between corrosion control and incrustation. Hardness is caused by the presence of certain dissolved chemical compounds with calcium and magnesium being the primary elements. The amount of hardness varies significantly depending on the source. The Arnprior raw water source has an average hardness of 49 mg/L, which would be considered soft water.

### **15.0 Alkalinity**

Alkalinity is a measure of the capacity of water to neutralize acids and is known as the buffering capacity. The recommended operational range for alkalinity in treated drinking water is 30mg/l to 500mg/l as Calcium Carbonate. The Arnprior raw water has an average alkalinity of 47 mg/L and the treated water an average of 59 mg/L.

### **16.0 Fluoride**

Hydrofluorosilicic acid is added to the treated water to attain an average fluoride residual in 2023 of 0.62 mg/L with a Maximum Acceptable Concentration of 1.5 mg/L. The fluoride residual is monitored with an online analyzer and in laboratory analysis.

### **17.0 Water Treatment Chemicals**

The WFP uses Chlorine gas, polymer, Ammonium Sulphate (Chloramination), Polyaluminum Chloride (Coagulant), Sodium Carbonate (Soda Ash), Phosphoric Acid (Corrosion Control), and Hydrofluorosilicic Acid (Fluoride).

**Completed by Jessica Schultz  
OIT  
Arnprior**

**Reviewed by Scott Matthews  
Waterworks Supervisor  
Arnprior**

For inquiries regarding this report, please contact Scott Matthews at 623-4231 Ext. 1834.